




Figure 7

Y-fitting By-pass with Wall Mounted Heating Unit

**Do Not Mount
The PH Treatment Tube
in Vertical Position**

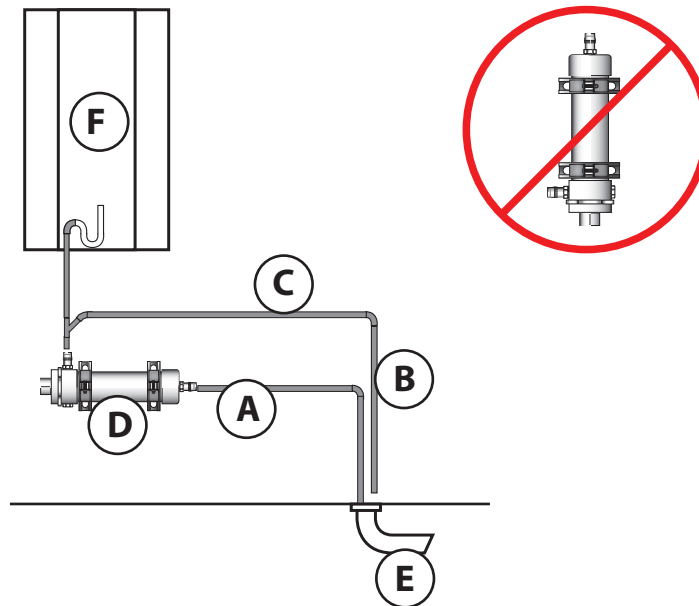

Key	
A	Boiler/Hot Water Heater/Furnace Condensate Drain
B	By-pass Drain
C	By-pass Piping
D	PH Treatment Tube
E	House Drain
F	Boiler, Hot Water Heater, Furnace

Note: Contact Factory for PH Treatment Tube and Tank Sizing and Piping Sizing